


HOISTWAY SECTION

SAFETY BEAM 5000 LBS. CAPACITY (BY OTHERS) CENTERED OVER RAILS AT TOP OF HOISTWAY. MAY REQUIRE REMOVAL LATER FOR LEGAL OVERHEAD.


SEE MIN. OVERHEAD TABLE

CONSULT LOCAL SALES OFFICE IF TRAVEL > 50 FT.

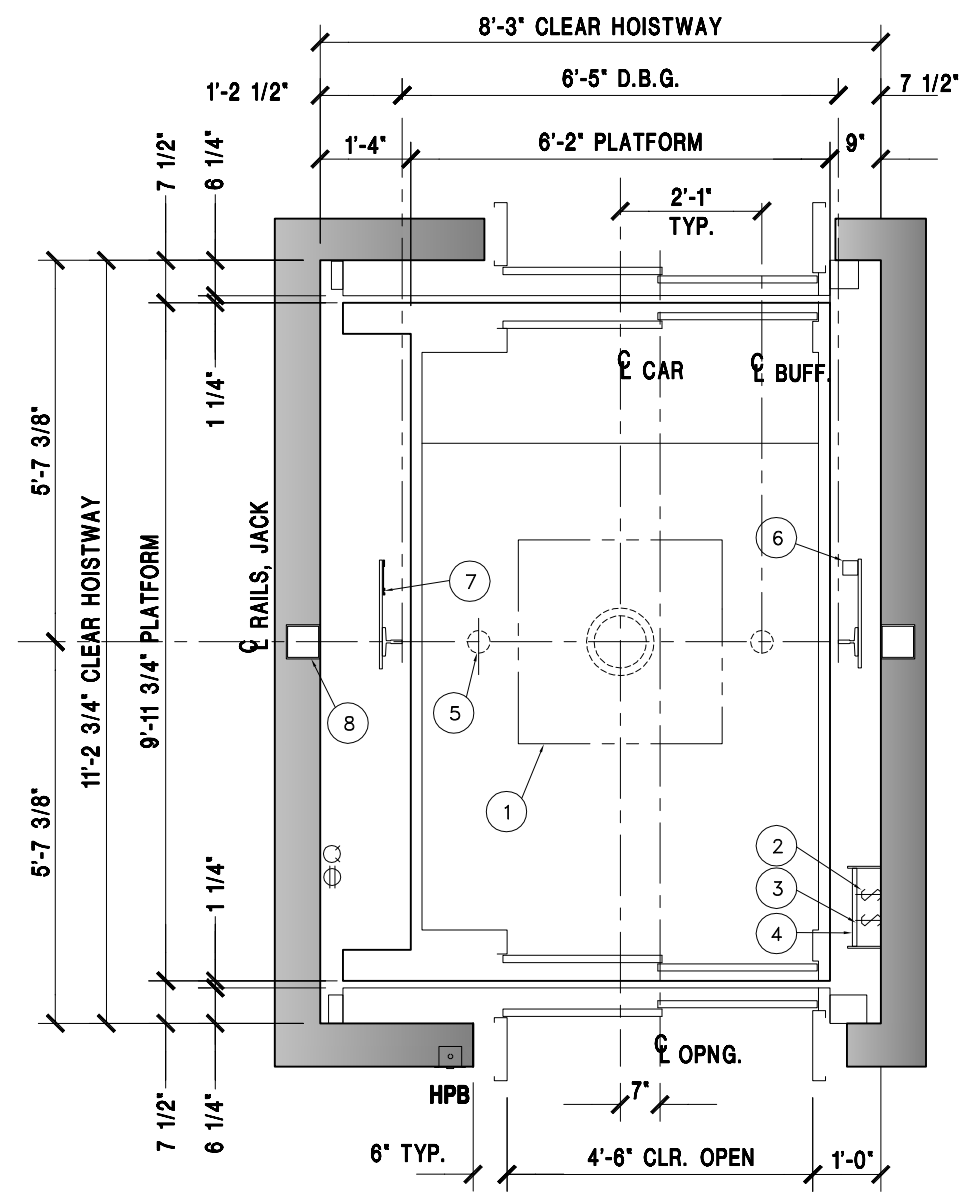

HOISTWAY PLAN

- ① 36" SQ. BLOCKOUT @ PIT FLR. FOR JACK UNIT
- ② LIGHT SWITCH-18" ABOVE LOWEST LANDING (BY OTHERS)
- ③ PIT STOP SWITCH
- ④ PIT LADDER (BY OTHERS)
- ⑤ SPRING BUFFERS LOCATED ON PIT FLOOR
- ⑥ LIMIT SWITCH
- ⑦ TAPE SELECTOR

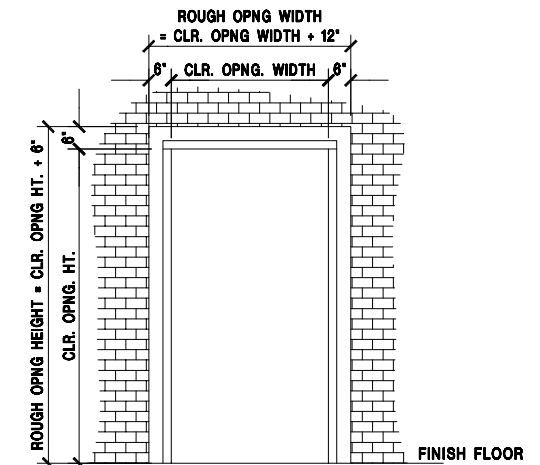

**ROUGH OPENING FOR ENTRANCE INSTALLATION
CMU, CONCRETE CONSTRUCTION ONLY;
ROUGH OPENING IS NOT REQUIRED FOR
DRY WALL CONSTRUCTION**

PLEASE NOTE THAT THESE RAIL REACTION NUMBERS ARE ESTIMATES AND ARE SUBJECT TO CHANGE AS ACCURATE INFORMATION BECOMES AVAILABLE.

SPECIFICATION		
USAGE	PASSENGER	
LOADING CLASS	A	
CAPACITY (LBS.)	5000	
RATED SPEED (FPM)	100,125,150	
RISE	MAX. 50'-0"	
RAIL REACTION (SEISMIC)		
	MAX. RAIL BRKT SPAN	14'-0"
	R1 (LBS.)	3110
	R2 (LBS.)	1555
	MAX. RAIL BRKT SPAN (DSA)	9'-0"
	R1 (LBS.)	2900
	R2 (LBS.)	1450
MIN. OVERHEAD REQUIRED		
ENTRANCE HEIGHT	CAB HEIGHT	MIN. OVERHEAD
7'-0"	8'-0"	12'-3"
	9'-0"	13'-3"
	10'-0"	14'-3"
8'-0"	9'-0"	13'-3"
	10'-0"	14'-3"
9'-0"	10'-0"	14'-3"

NOTE: IF CAR TOP GUARD RAIL IS REQUIRED, ADD 3" TO THE MIN O.H.

REV.	DATE	BY	REVISIONS

NOTE:
WHEN THE EQUIPMENT HAS BEEN RELEASED FOR FABRICATION. ANY CHANGES MADE AFTER APPROVAL WILL RESULT IN ADDITIONAL COST AND COMPLETION TIME.

FOR APPROVAL
 REVISED FOR APPROVAL
 FINAL DISTRIBUTION
 REVISED FINAL DISTRIBUTION

PROJECT: ----
 ADDRESS: ----
 CONTRACTOR: ----
 ARCHITECT: ----
 CONSULTANT: ----
 DRAWN: **JC** DATE: **9/6/13** APPROVED: **JC**
 DWG. TITLE: **HOISTWAY PLAN & SECTION**
 PROJECT NO.: ---- ELE#: **1**