



**HOISTWAY SECTION**

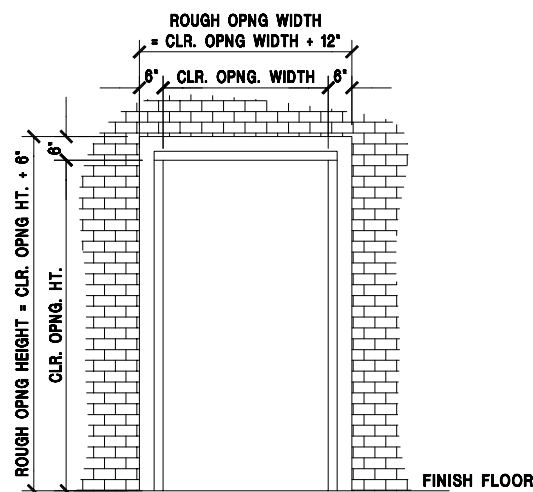

ROUGH OPENING FOR ENTRANCE INSTALLATION  
CMU, CONCRETE CONSTRUCTION ONLY;  
ROUGH OPENING IS NOT REQUIRED FOR  
DRY WALL CONSTRUCTION

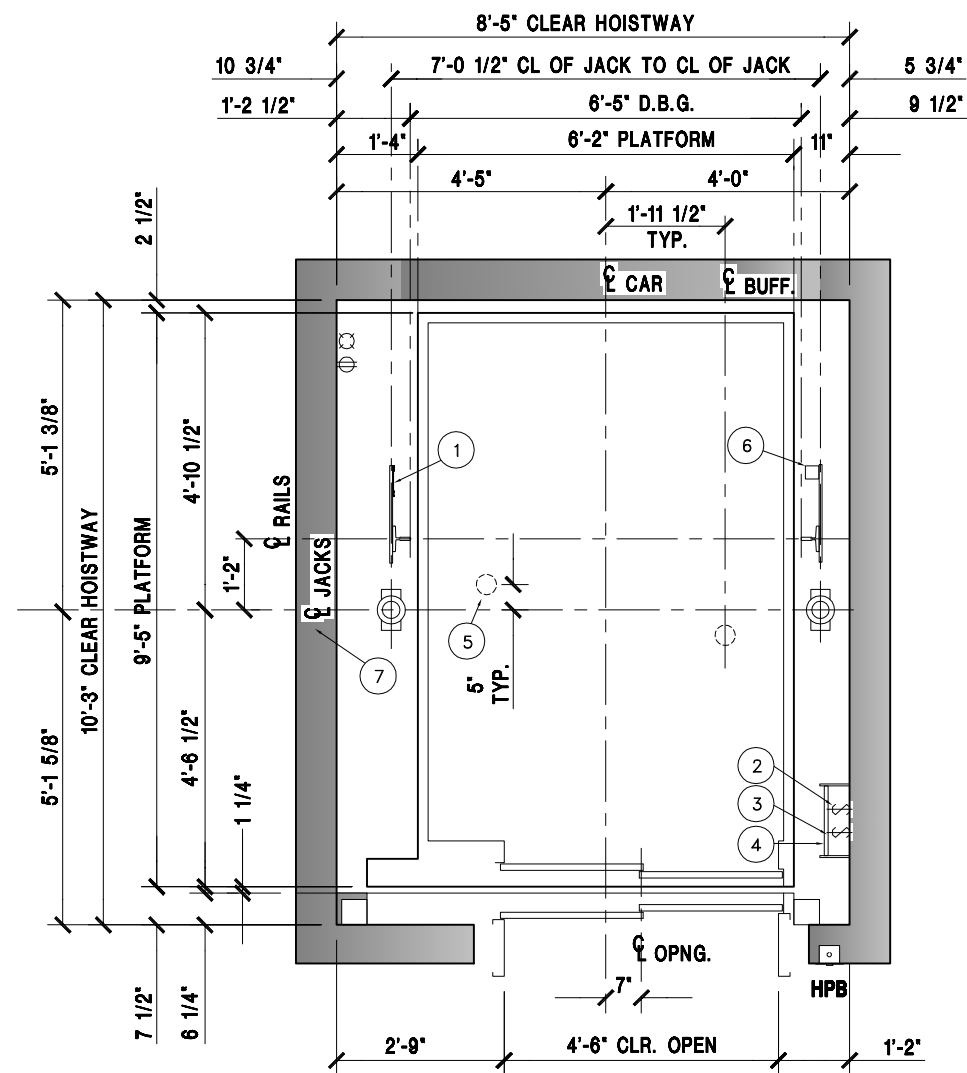

**HOISTWAY PLAN**

- 1 TAPE SELECTOR
- 2 LIGHT SWITCH-18" ABOVE LOWEST LANDING (BY OTHERS)
- 3 PIT STOP SWITCH
- 4 PIT LADDER ( BY OTHERS )
- 5 SPRING BUFFERS LOCATED ON PIT FLOOR
- 6 LIMIT SWITCH

**PLEASE NOTE THAT THESE RAIL REACTION NUMBERS ARE ESTIMATES AND ARE SUBJECT TO CHANGE AS ACCURATE INFORMATION BECOMES AVAILABLE.**

SPECIFICATION	
USAGE	SERVICE
LOADING CLASS	A
CAPACITY (LBS.)	5000
RATED SPEED (FPM)	100,125,150
RISE	MAX. 15'-0"

RAIL REACTION (SEISMIC)		
R1 → R2	MAX. RAIL BRKT SPAN	14'-0"
	R1 (LBS.)	2800
	R2 (LBS.)	1400
	MAX. RAIL BRKT SPAN (DSA)	9'-0"
	R1 (LBS.)	2580
	R2 (LBS.)	1290

REV.	DATE	BY	REVISIONS

**NOTE:**  
WHEN THE EQUIPMENT HAS BEEN RELEASED FOR FABRICATION, ANY CHANGES MADE AFTER APPROVAL WILL RESULT IN ADDITIONAL COST AND COMPLETION TIME.

FOR APPROVAL  
 REVISED FOR APPROVAL  
 FINAL DISTRIBUTION  
 REVISED FINAL DISTRIBUTION

PROJECT: ----  
 ADDRESS: ----  
 CONTRACTOR: ----  
 ARCHITECT: ----  
 CONSULTANT: ----  
 DRAWN: JC DATE: 9/6/13 APPROVED: JC  
 DWG. TITLE: HOISTWAY PLAN & SECTION  
 PROJECT NO.: --- ELE#: 1