
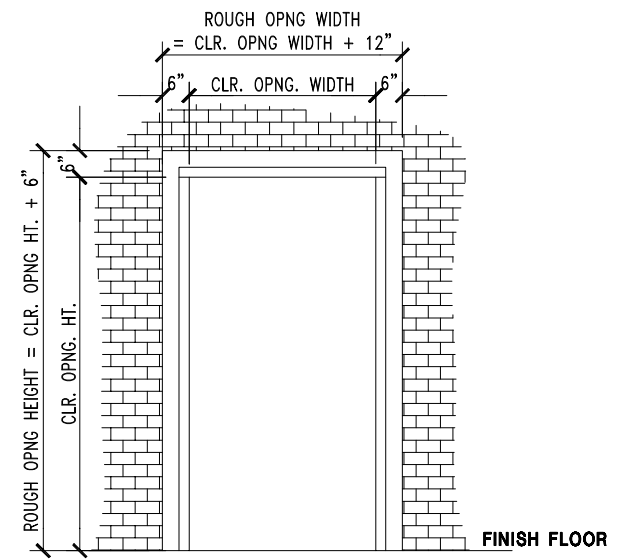


**SAFETY BEAM 5000 LBS. CAPACITY (BY OTHERS) CENTERED OVER RAILS AT TOP OF HOISTWAY. MAY REQUIRE REMOVAL LATER FOR LEGAL OVERHEAD.**

**SEE HOLELESS ELEVATOR MIN OVERHEAD MATRIX.**

**CONSULT LOCAL SALES OFFICE IF TRAVEL > 15 FT.**

**HOISTWAY SECTION**

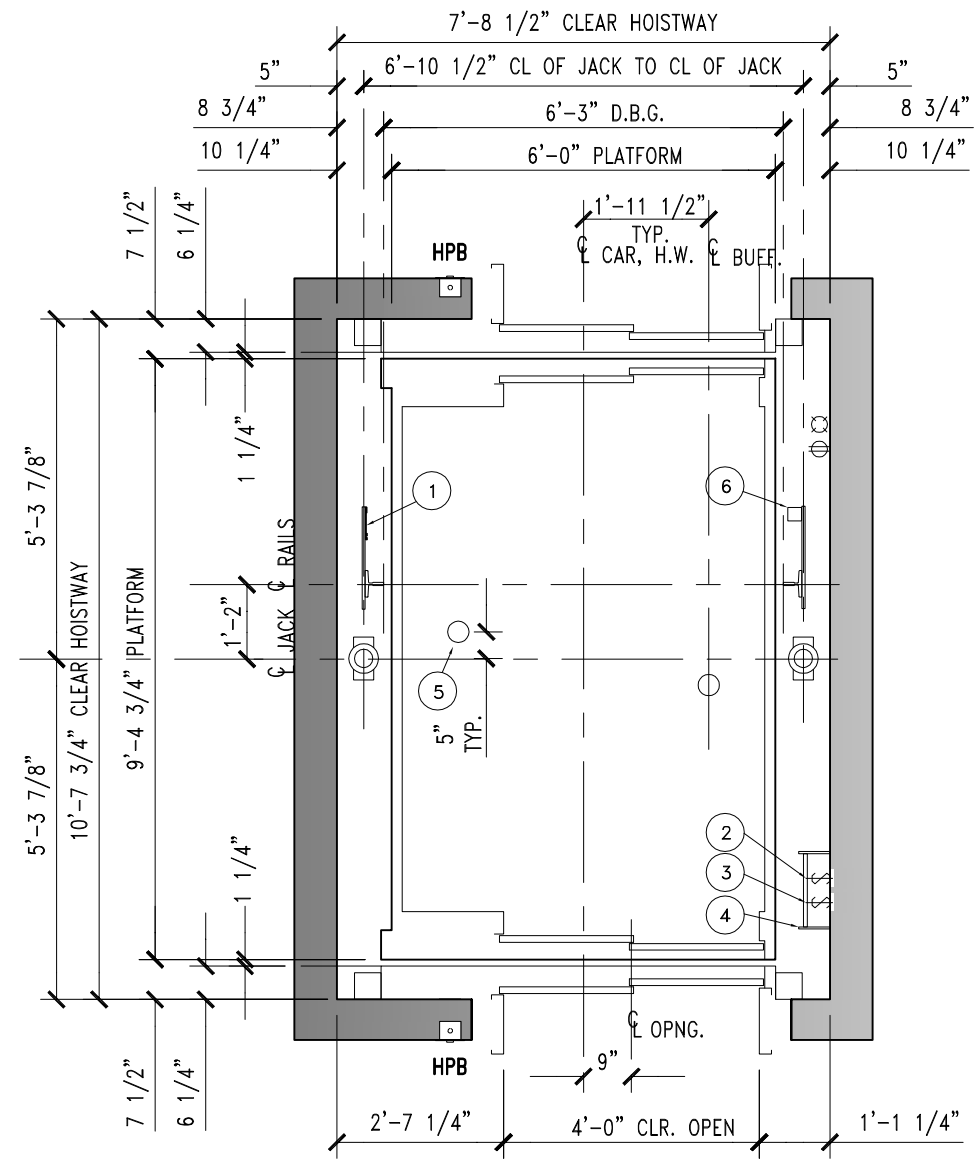

**ROUGH OPENING FOR ENTRANCE INSTALLATION  
CMU, CONCRETE CONSTRUCTION ONLY;  
ROUGH OPENING IS NOT REQUIRED FOR  
DRY WALL CONSTRUCTION**

**HOISTWAY PLAN**

- 1 TAPE SELECTOR
- 2 LIGHT SWITCH-18" ABOVE LOWEST LANDING (BY OTHERS)
- 3 PIT STOP SWITCH
- 4 PIT LADDER ( BY OTHERS )
- 5 SPRING BUFFERS LOCATED ON PIT FLOOR
- 6 LIMIT SWITCH

PLEASE NOTE THAT THESE RAIL REACTION NUMBERS ARE ESTIMATES AND ARE SUBJECT TO CHANGE AS ACCURATE INFORMATION BECOMES AVAILABLE.

SPECIFICATION		
USAGE	SERVICE	
LOADING CLASS	A	
CAPACITY (LBS.)	4500	
RATED SPEED (FPM)	100,125	
RISE	MAX. 15'-0"	
RAIL REACTION (SEISMIC)		
R2 R1	MAX. RAIL BRKT SPAN	14'-0"
	R1 (LBS.)	2653
	R2 (LBS.)	1326
	MAX. RAIL BRKT SPAN (DSA)	9'-0"
	R1 (LBS.)	2454
	R2 (LBS.)	1227
REV.	DATE	BY REVISIONS
<b>NOTE:</b> WHEN THE EQUIPMENT HAS BEEN RELEASED FOR FABRICATION. ANY CHANGES MADE AFTER APPROVAL WILL RESULT IN ADDITIONAL COST AND COMPLETION TIME.		
<input checked="" type="checkbox"/> FOR APPROVAL <input type="checkbox"/> REVISED FOR APPROVAL <input type="checkbox"/> FINAL DISTRIBUTION <input type="checkbox"/> REVISED FINAL DISTRIBUTION		
PROJECT: ----		
ADDRESS: ----		
CONTRACTOR: ----		
ARCHITECT: ----		
CONSULTANT: ----		
DRAWN: JC	DATE: 9/6/13	APPROVED: JC
DWG. TITLE: HOISTWAY PLAN & SECTION		
PROJECT NO.: ---		ELE#: 1