

- NOTES:
1. WHEN THE CANOPY HEIGHT IS CHANGED FROM THE DIMENSION ON THIS DRAWING, OVERHEAD AND THE BRACKET SPAN FOR UPPER RAILS SHALL BE CHANGED AS WELL.
 2. "TRAVEL ABOVE GROUND" + "OVERHEAD" MUST BE LESS THAN 295'-0" (90 METERS).
 3. REGENERATIVE POWER (PCNV) IS ALWAYS REQUIRED FOR THIS DUTY.
 4. WIRING DISTANCE BETWEEN CONTROL PANEL AND TRACTION MACHINE MUST BE WITHIN 98'-5" (30 METERS) FOR THIS DUTY.

DISCLAIMER:

THESE CAD DRAWINGS SHOULD BE USED FOR REFERENCE ONLY. MEUS DISCLAIMS ALL RESPONSIBILITY FOR ANY REPRODUCTION, MODIFICATION, DISTRIBUTION OR INTEGRATION OF THESE CAD DRAWINGS INTO OTHER ARCHITECTURAL AND STRUCTURAL DRAWINGS. MEUS MARKETS NO WARRANTIES OF ANY KIND WITH RESPECT TO THE ACCURACY OR COMPLETENESS OF THESE CAD SCHEMATIC DRAWINGS FOR ANY PURPOSE. MEUS HEREBY EXPRESSLY DISCLAIMS ALL WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING THE IMPLIED WARRANTIES OF MERCHANT ABILITY AND FITNESS FOR A PARTICULAR PURPOSE.

Copyright (c) 2005 Mitsubishi Electric & Electronic USA, Inc. All rights reserved.

SPECIFICATIONS	
SERIES	DIAMOND TRAC
LOAD	4000 LBS [1800 kg]
SPEED	400 FPM [120 m/min]
REGULATION / CODE	ASME A17.1S - 2005
TRAVEL	MAX. TRAVEL : 262'-0" [80 m]
DOOR TYPE	CO
GUIDE RAIL	CAR 18.5 LBS CWT 18.5 LBS
CWT SAFETY	APPLIED

RAIL BRACKET SPACING			
SEISMIC ZONE	ZONE 0 TO 2		ZONE 3 & 4
RAIL SIZE	18.5 LBS		18.5 LBS
RAIL BRACKET SPACING	CAR 15'-10 15/16" [4850]	CWT 16'-4 7/8" [5000]	CAR CWT 13'-5 7/16" [4100] 12'-9 9/16" [3900]

RAIL REACTION LOAD				
SEISMIC ZONE	CAR RAIL A, B		CWT RAIL C, D	
	F1X	F1Y	F1X	F1Y
ZONE 3 & 4	3900 LBS	2000 LBS	4200 LBS	2100 LBS

CAR HITCH BEAM LOAD			
STATIC LOAD		DYNAMIC LOAD	
RA	RB	RA	RB
5900 LBS [27000 N]	1800 LBS [8000 N]	11500 LBS [51200 N]	3600 LBS [16000 N]


PIT REACTION LOAD						
SEISMIC ZONE (RAIL SIZE)	RAIL REACTION LOAD				BUFFER REACTION LOAD	
	R1	R2	R3	R4	P1	P2
WITH CWT SAFETY	18.5 LBS	20400 LBS [91000 N]	19300 LBS [86000 N]	19800 LBS [88000 N]	12600 LBS [56000 N]	51700 LBS [230000 N] 43800 LBS [195000 N]

POWER FEEDER DATA 1CAR												
MOTOR	STANDARD VOLTAGE 208V				STANDARD VOLTAGE 480V				POWER SUPPLY CAPACITY [kVA]	HEAT EMISSION		
	[HP]	[kW]	FLU [A]	FLAcc [A]	BREAKER IN CONTROL PANEL [A]	FLU [A]	FLAcc [A]	BREAKER IN CONTROL PANEL [A]		HOISTWAY (EXCEPT CAR LIGHTING) [BTU/Hr]	CONTROL PANEL ROOM [W]	
33.5	25	116	215	115	50	93	50	25	5120	1500	14160	4150

POWER CURRENT CORRESPONDING TO LOCAL SUPPLY VOLTAGE (FLU or FLAcc) [A]
 = EACH CURRENT (FLU or FLAcc)[A] x STANDARD VOLTAGE (E1 or E2)[V]
 LOCAL SUPPLY VOLTAGE (E) [V]

NO.	DATE	BY	REVISIONS
-	03/16/10	-	CREATED DRAWING

PROJECT:	-
ELEV. NO.:	-
DWG. TITLE:	-
ADMIN. NO.:	-
DWG. NO.:	EZ-B-0135
REV.	-

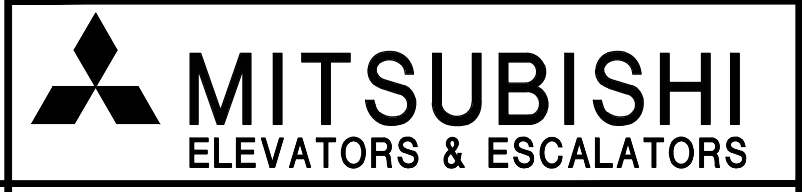

NOT TO BE USED FOR CONSTRUCTION **DIAMOND TRAC**

SCALE : 1/50