



HOISTWAY PLAN  
WITHOUT CWT SAFETY

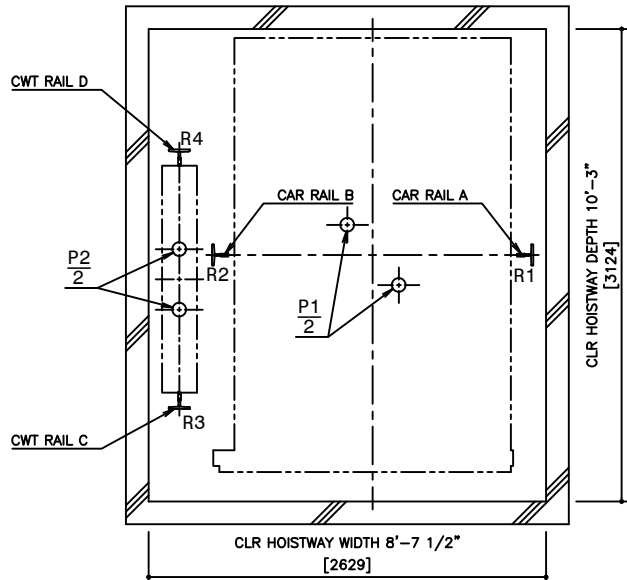


PIT PLAN  
WITHOUT CWT SAFETY

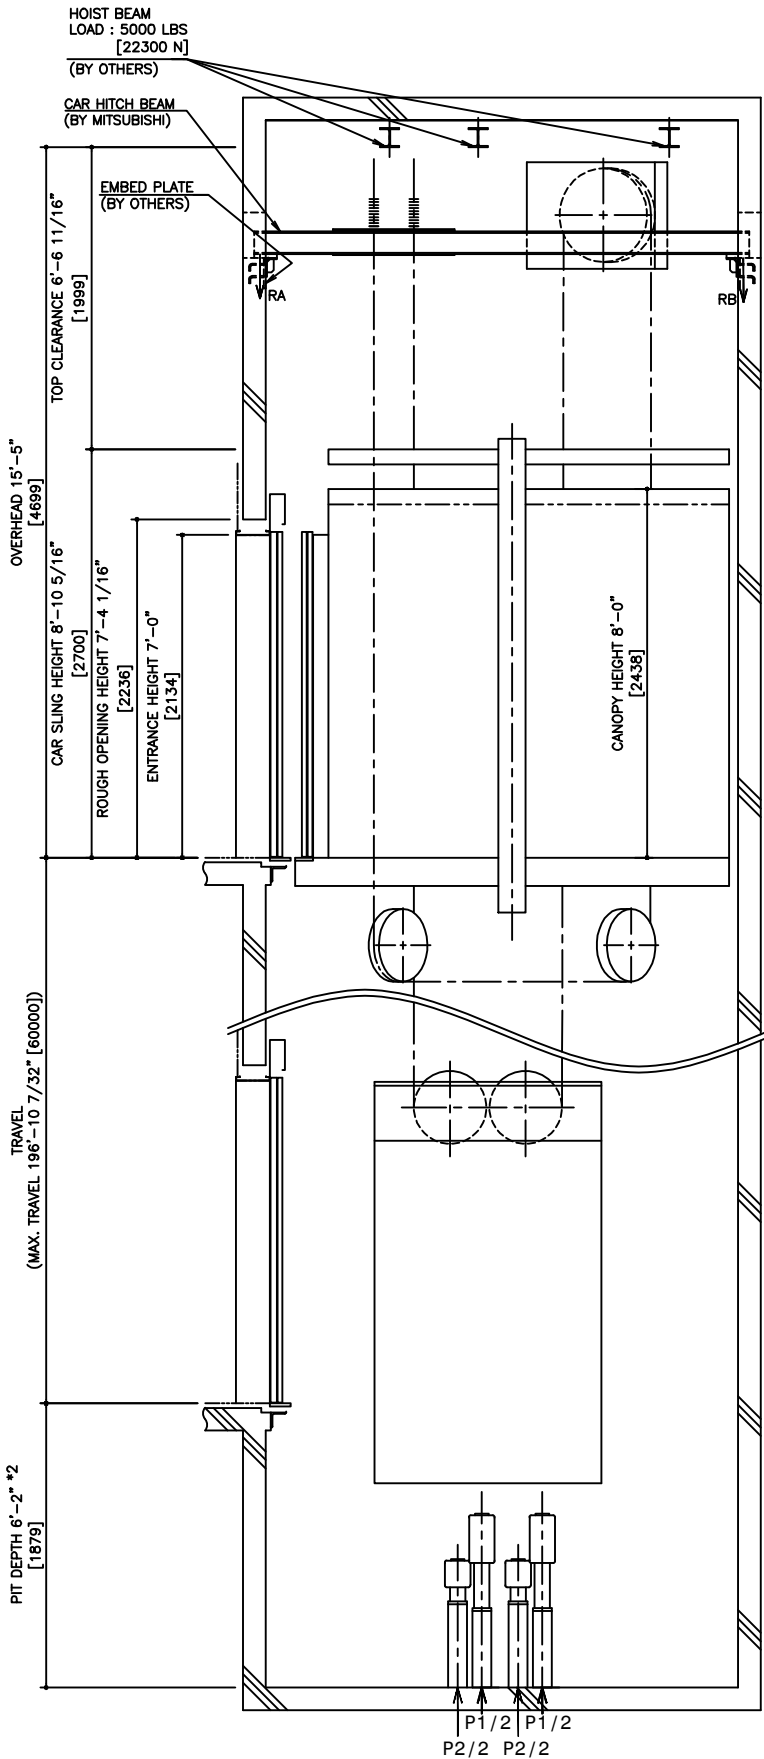

HOISTWAY SECTION  
WITHOUT CWT SAFETY

SPECIFICATIONS	
SERIES	DIAMOND TRAC
LOAD	5000 LBS [2250 kg]
SPEED	350 FPM [105 m/min]
REGULATION / CODE	ASME A17.1S - 2005
TRAVEL	MAX. TRAVEL : 196'-10 7/32" [60000]
DOOR TYPE	2S
GUIDE RAIL	CAR T127-1/B, T127-2/B, T140-1/B
CWT	T127-1/B, T127-2/B, T140-1/B
CWT SAFETY	NOT APPLIED

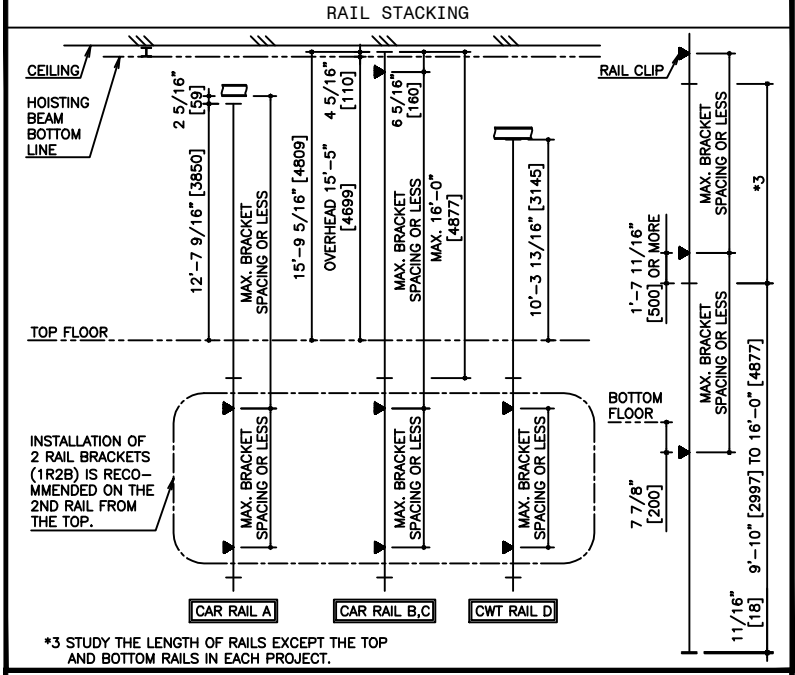

RAIL BRACKET SPACING					
SEISMIC ZONE	ZONE 0 TO 2			ZONE 3 & 4	
RAIL SIZE	T127-1/B	T127-2/B	T140-1/B	T127-1/B	T140-1/B
RAIL BRACKET SPACING	CAR	CWT	CAR	CWT	CWT
	9'-6 3/16" [2900]	10'-4" [3150]	12'-5 5/8" [3800]	13'-3 7/16" [4050]	15'-5 1/16" [4700]
	12'-5 5/8" [3800]	13'-3 7/16" [4050]	15'-5 1/16" [4700]	16'-4 7/8" [5000]	18'-2 13/16" [5500]
	15'-5 1/16" [4700]	16'-4 7/8" [5000]	18'-2 13/16" [5500]	19'-10 11/16" [6000]	21'-5 5/8" [6500]
	18'-2 13/16" [5500]	19'-10 11/16" [6000]	21'-5 5/8" [6500]	23'-0" [7000]	24'-5 5/8" [7500]

RAIL REACTION LOAD				
SEISMIC ZONE	CAR RAIL A, B		CWT RAIL C, D	
	FIX	FIY	FIX	FIY
ZONE 0 TO 2	2000 LBS [8900 N]	1000 LBS [4500 N]	2300 LBS [10300 N]	1200 LBS [5400 N]
ZONE 3 & 4	4000 LBS [17800 N]	2000 LBS [8900 N]	4500 LBS [20100 N]	2300 LBS [10300 N]

CAR HITCH BEAM LOAD			
STATIC LOAD		DYNAMIC LOAD	
RA	RB	RA	RB
6000 LBS [27000 N]	1700 LBS [8000 N]	11900 LBS [53000 N]	3400 LBS [16000 N]

PIT REACTION LOAD						
SEISMIC ZONE (RAIL SIZE)	RAIL REACTION LOAD				BUFFER REACTION LOAD	
	R1	R2	R3	R4	P1	P2
T127-1/B	16900 LBS [74800 N]	20300 LBS [90300 N]	4100 LBS [18100 N]	16300 LBS [72300 N]	56000 LBS [249000 N]	45900 LBS [204000 N]
T127-2/B	17600 LBS [78100 N]	21100 LBS [93500 N]	4800 LBS [21400 N]	17000 LBS [75600 N]	56000 LBS [249000 N]	45900 LBS [204000 N]
T140-1/B	18300 LBS [81300 N]	21800 LBS [96700 N]	5600 LBS [24600 N]	17800 LBS [78800 N]	56000 LBS [249000 N]	45900 LBS [204000 N]

POWER FEEDER DATA 1CAR									
MOTOR	STANDARD VOLTAGE 208V				STANDARD VOLTAGE 480V				POWER SUPPLY CAPACITY [kVA]
	CURRENT	FLU	FLAcc	BREAKER IN CONTROL PANEL [A]	CURRENT	FLU	FLAcc	BREAKER IN CONTROL PANEL [A]	
[HP] [kW]	[A]	[A]	[A]	[A]	[A]	[A]	[A]	[A]	[kVA]
33.5 25	110 196	150	48	85	60	24	5120 1500 10240 3000		

POWER CURRENT CORRESPONDING TO LOCAL SUPPLY VOLTAGE (FLU or FLAcc) [A]  
 = EACH CURRENT (FLU or FLAcc) [A] X STANDARD VOLTAGE (E1 or E2) [V]  
 = EACH CURRENT (FLU or FLAcc) [A] X LOCAL SUPPLY VOLTAGE (E) [V]

**DISCLAIMER:**  
 THESE CAD DRAWINGS SHOULD BE USED FOR REFERENCE ONLY. MEUS DISCLAIMS ALL RESPONSIBILITY FOR ANY REPRODUCTION, MODIFICATION, DISTRIBUTION OR INTEGRATION OF THESE CAD DRAWINGS INTO OTHER ARCHITECTURAL AND STRUCTURAL DRAWINGS. MEUS MARKETS NO WARRANTIES OF ANY KIND WITH RESPECT TO THE ACCURACY OR COMPLETENESS OF THESE CAD SCHEMATIC DRAWINGS FOR ANY PURPOSE. MEUS HEREBY EXPRESSLY DISCLAIMS ALL WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE.  
 Copyright (c) 2005 Mitsubishi Electric & Electronic USA, Inc. All rights reserved.

NOTE :  
 WHEN THE CANOPY HEIGHT IS CHANGED FROM THE DIMENSION ON THIS DRAWING, OVERHEAD AND THE BRACKET SPAN FOR UPPER RAILS SHALL BE CHANGED AS WELL.

\*1,\*2 : AS SHOWN IN THE FIGURE ABOVE, AN INSPECTION HATCH FOR USE IN THE MAINTENANCE OF THE CAR DOOR OPERATOR SHALL BE PROVIDED ABOVE THE ENTRANCE ON THE BOTTOM FLOOR, IF THE LANDING IS THE ONLY ONE IN THAT SIDE. HOWEVER, THIS INSPECTION HATCH WILL BE UNNECESSARY, IF THE PIT DEPTH CAN BE DEEPENED BY 0'-6 1/2" [165].

NO.	DATE	BY	REVISIONS
-	03/16/10	-	CREATED DRAWING

PROJECT: -  
 ELEV. NO.: -  
 DWG. TITLE: -  
 ADMIN. NO.: -  
 DWG. NO.: EZ-B-0101  
 REVISIONS: -  
  
**DIAMOND TRAC**  
 ADMIN. NO [B-AM11KA-3152S-105-S0-NO]

SCALE : 1/50

NOT TO BE USED FOR CONSTRUCTION